


HTS-10-P2 SYSTEM COMPONENT CALL-OUT

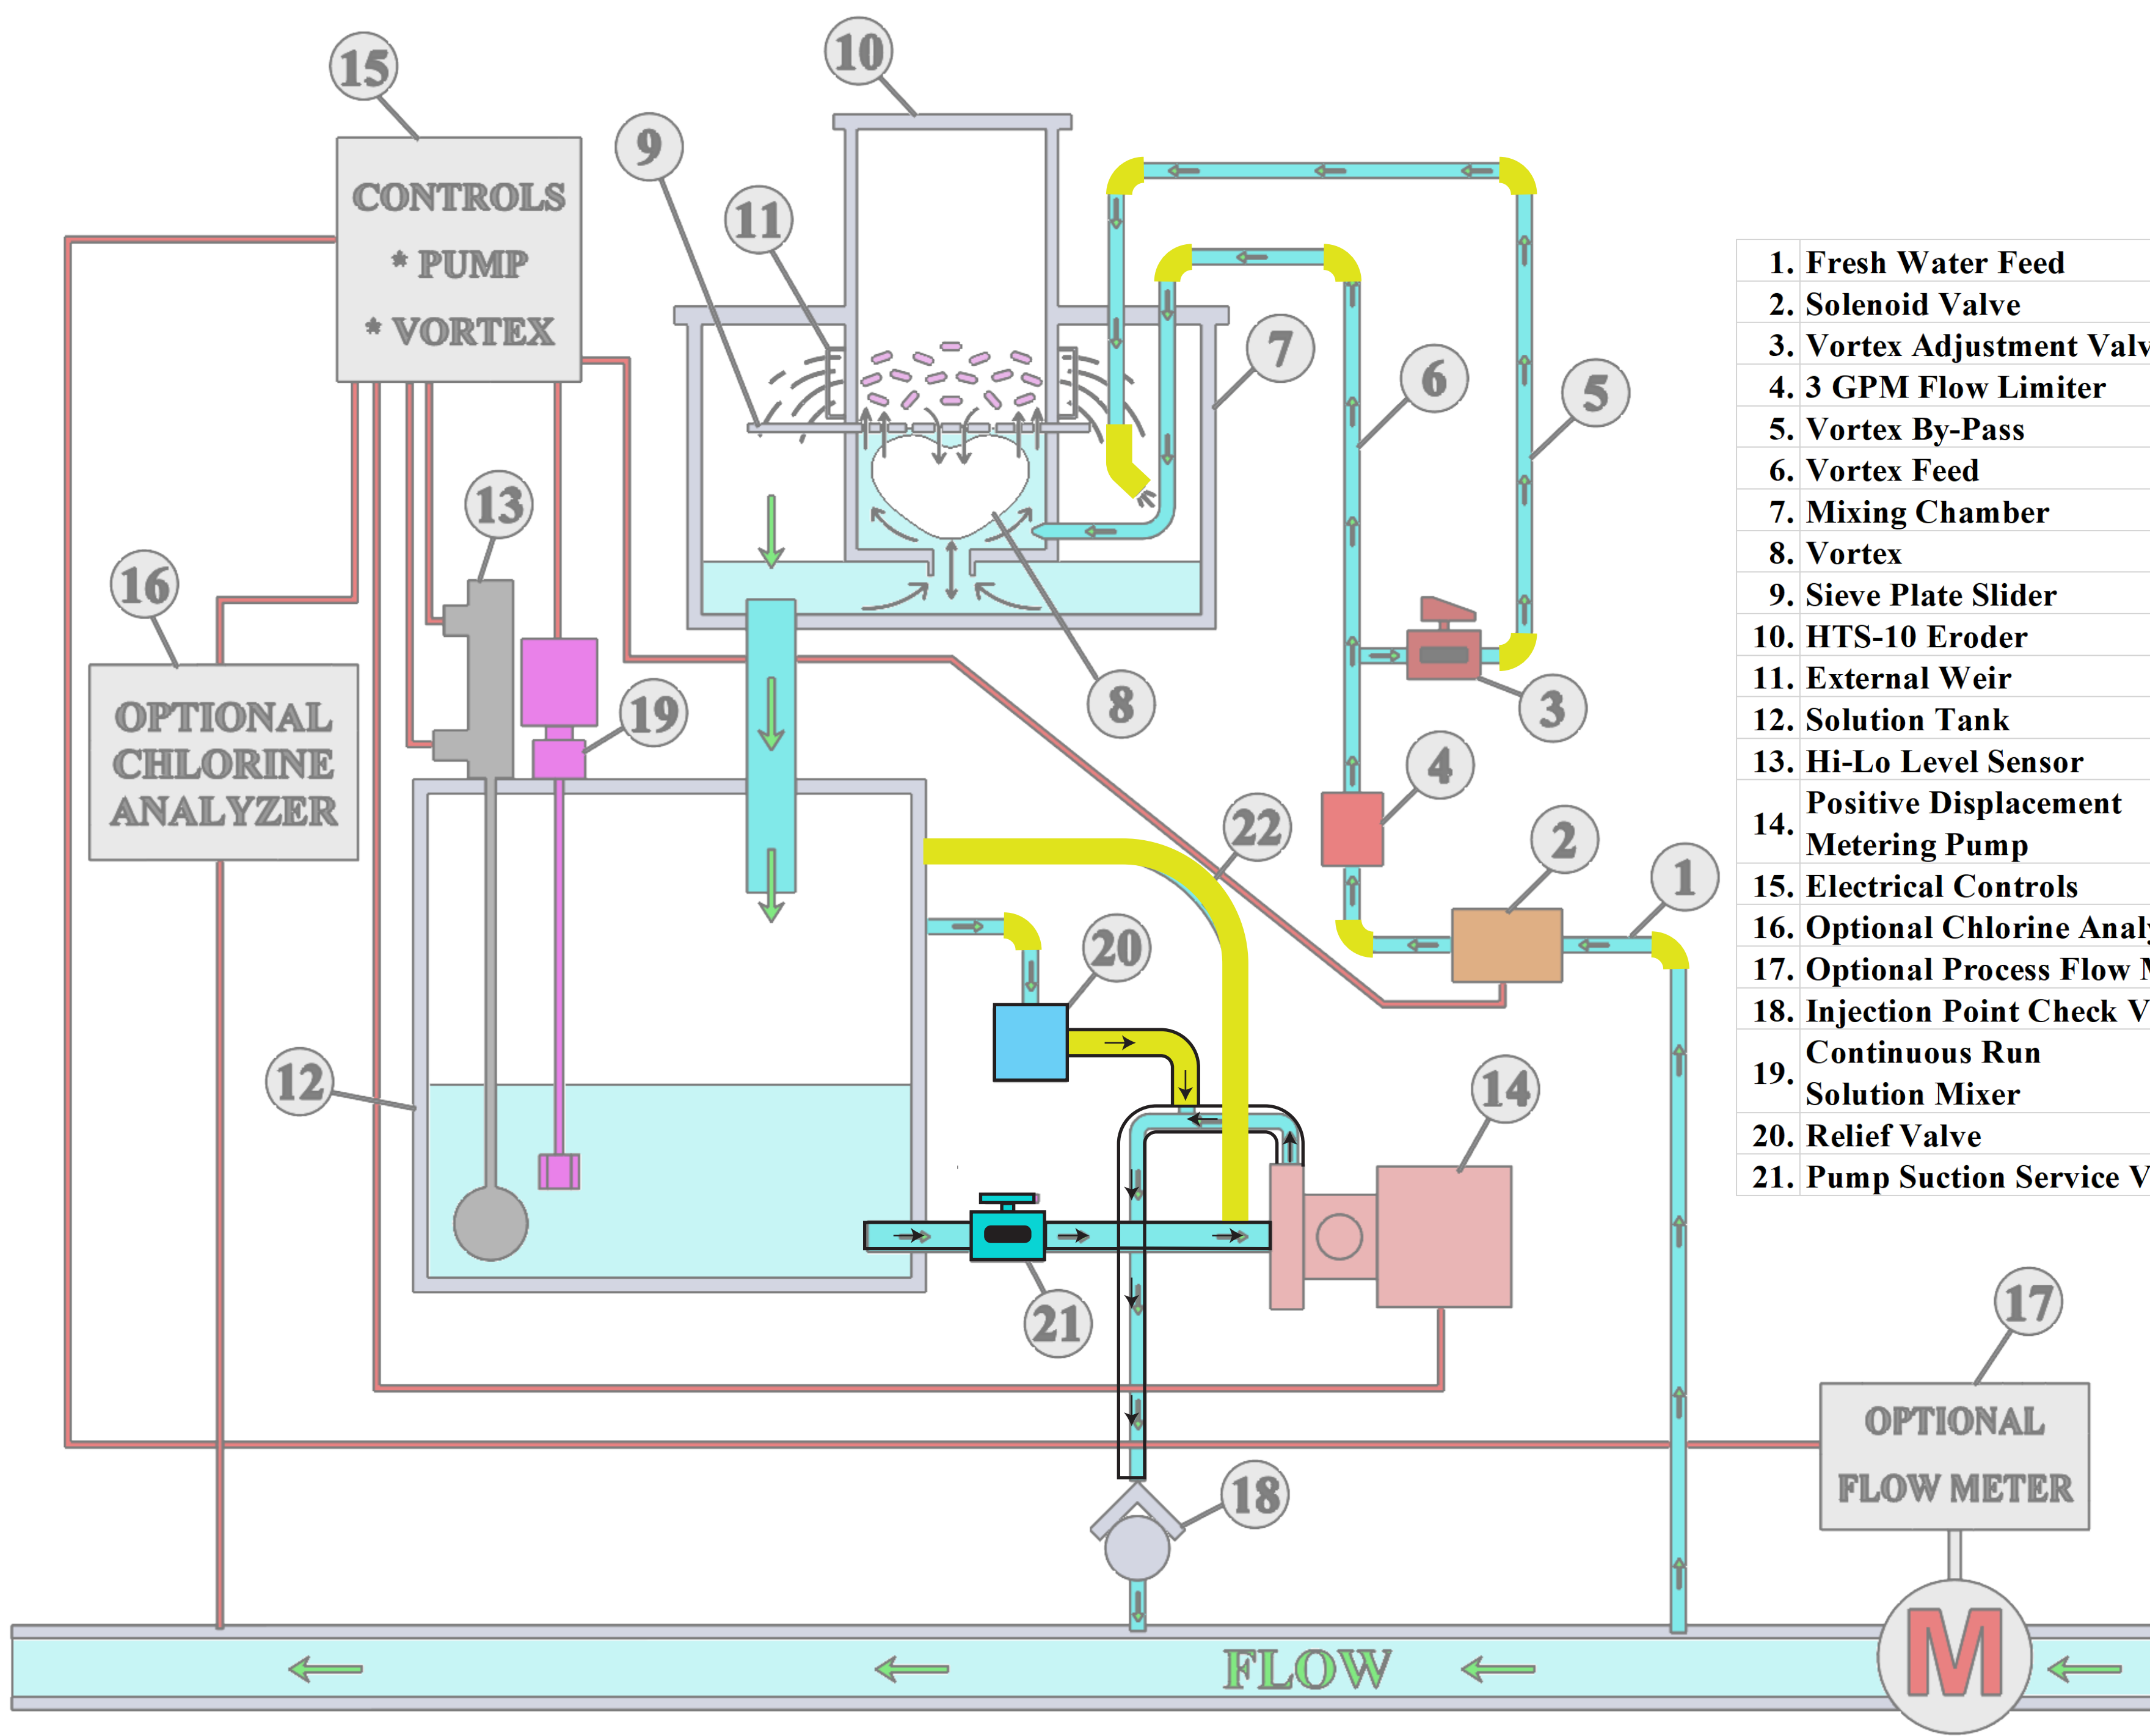

- 1. Fresh Water Feed
- 2. Solenoid Valve
- 3. Vortex Adjustment Valve
- 4. 3 GPM Flow Limiter
- 5. Vortex By-Pass
- 6. Vortex Feed
- 7. Mixing Chamber
- 8. Vortex
- 9. Sieve Plate Slider
- 10. HTS-10 Eroder
- 11. External Weir
- 12. Solution Tank
- 13. Hi-Lo Level Sensor
- 14. Positive Displacement Metering Pump
- 15. Electrical Controls
- 16. Optional Chlorine Analyzer
- 17. Optional Process Flow Meter
- 18. Injection Point Check Valve
- 19. Continuous Run Solution Mixer
- 20. Relief Valve
- 21. Pump Suction Service Valve

NOTES: 1)

HAMMONDS
DOC. APPROVED FOR
INITIAL RELEASE
ENG. CHANGE
X-REVISION 0
DATE 05/14/2024
BY JH

HAMMONDS TECHNICAL SERVICES INC www.hammondscos.com	
HTS-10-P2 TECHNICAL SCHEMATIC PN:HIW-1.0	
DATE: 05/09/2024	DO NOT SCALE
ENGR: CH	REV. 0
PR MGR:	
SCALE: NTS	WEIGHT: LBS
SIGNATURES ON FILE	
SHEET 1 OF 1	

ZONE	REV.	DESCRIPTION	REVISIONS
0		INITIAL RELEASE	
05/14/2024		DATE	
JH		APPROVED	