HTS-80 SYSTEM COMPONENT CALL-OUT

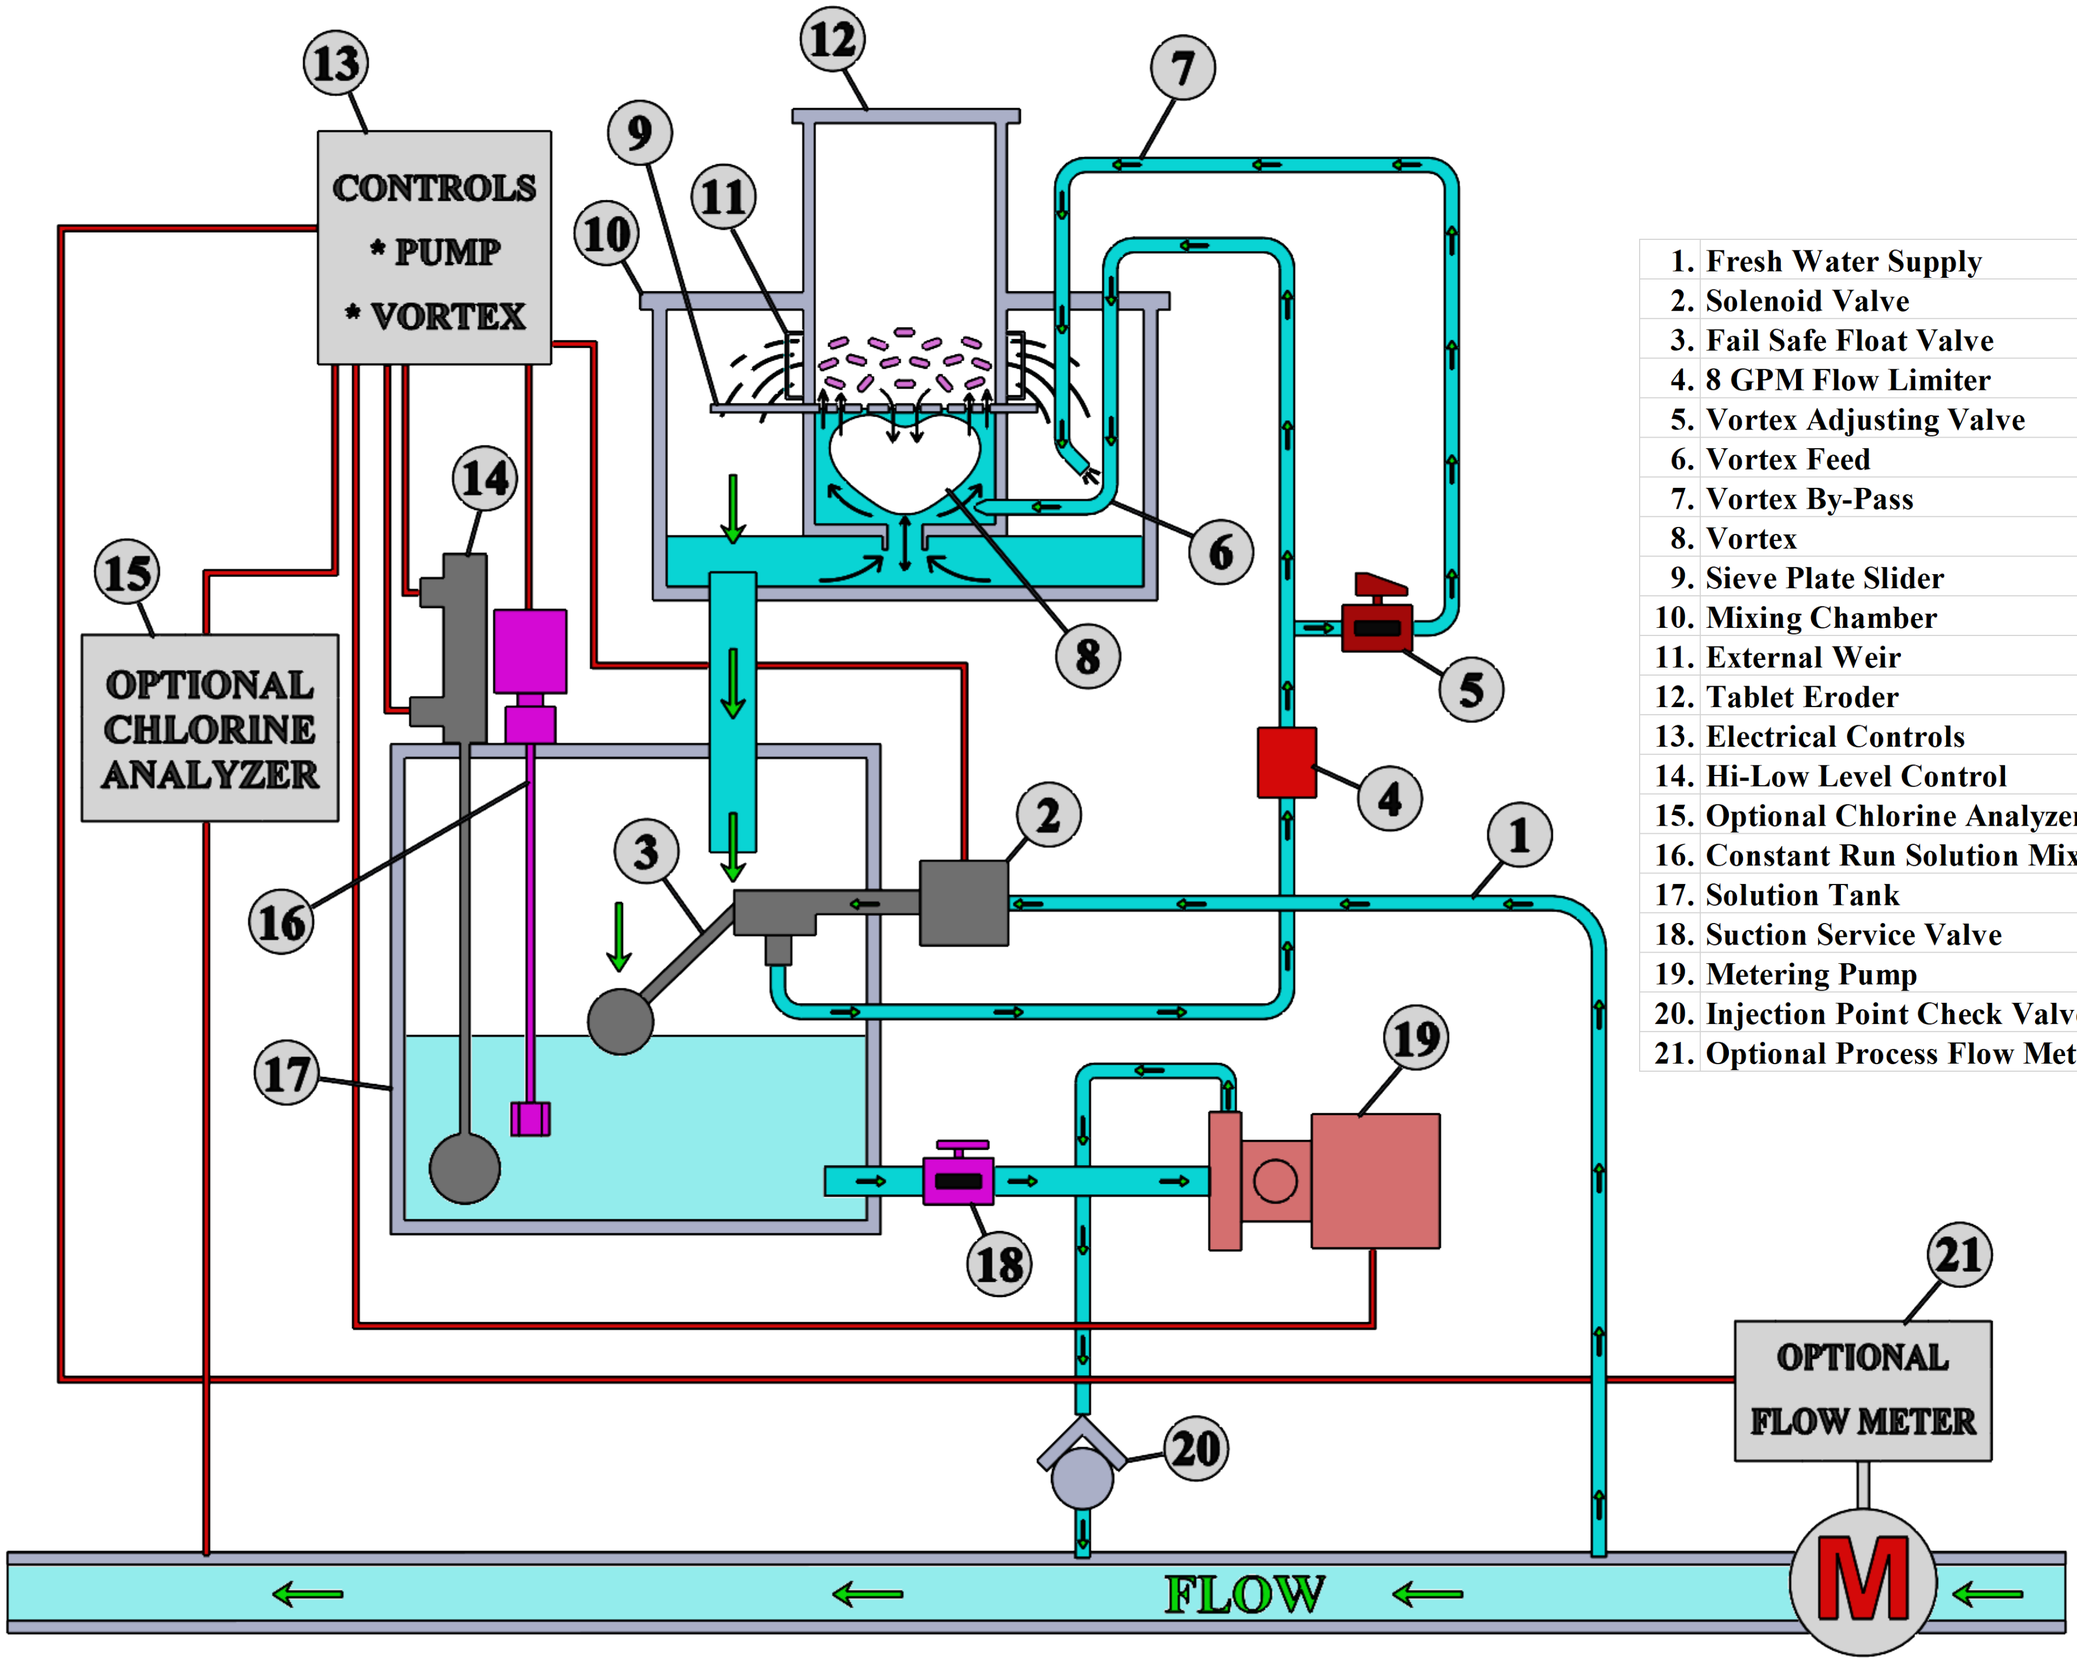

1.	Fresh Water Supply
2.	Solenoid Valve
3.	Fail Safe Float Valve
4.	8 GPM Flow Limiter
5.	Vortex Adjusting Valve
6.	Vortex Feed
7.	Vortex By-Pass
8.	Vortex
9.	Sieve Plate Slider
10.	Mixing Chamber
11.	External Weir
12.	Tablet Eroder
13.	Electrical Controls
14.	Hi-Low Level Control
15.	Optional Chlorine Analyzer
16.	Constant Run Solution Mixer
17.	Solution Tank
18.	Suction Service Valve
19.	Metering Pump
20.	Injection Point Check Valve
21.	Optional Process Flow Meter

HAMMONDS TECHNICAL SERVICES INC
www.hammondscos.com

TITLE: HTS-80 TECHNICAL SCHEMATIC PN:HIW-2.0

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO HAMMONDS TECHNICAL SERVICES INC. THE INFORMATION CONTAINED HEREIN SHALL NOT BE DISCLOSED, DUPLICATED, USED IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN THE PURPOSE FOR WHICH THIS DOCUMENT WITHOUT WRITTEN CONSENT OF HAMMONDS TECHNICAL SERVICES, INC.

DRAWN: CLD	DATE: 05/09/2024	3RD ANGLE PROJECTION	DO NOT SCALE
ENGR: CH	DATE: 01/01/2024	SIZE C	DWG. NO. HIW-2.0	REV. 0
PR MGR:	DATE:	SCALE: NTS	WEIGHT: - LBS	SHEET 1 OF 1

eSIGNATURES ON FILE

HAMMONDS
DOC. APPROVED FOR
INITIAL RELEASE
ENG. CHANGE
X-REVISION 0
DATE 05/14/2024
BY JH

NOTES: 1)

REVISIONS

ZONE	REV.	DESCRIPTION	DATE	APPROVED
	0	INITIAL RELEASE	05/14/2024	JH