


HTS-80 SYSTEM COMPONENT CALL-OUT

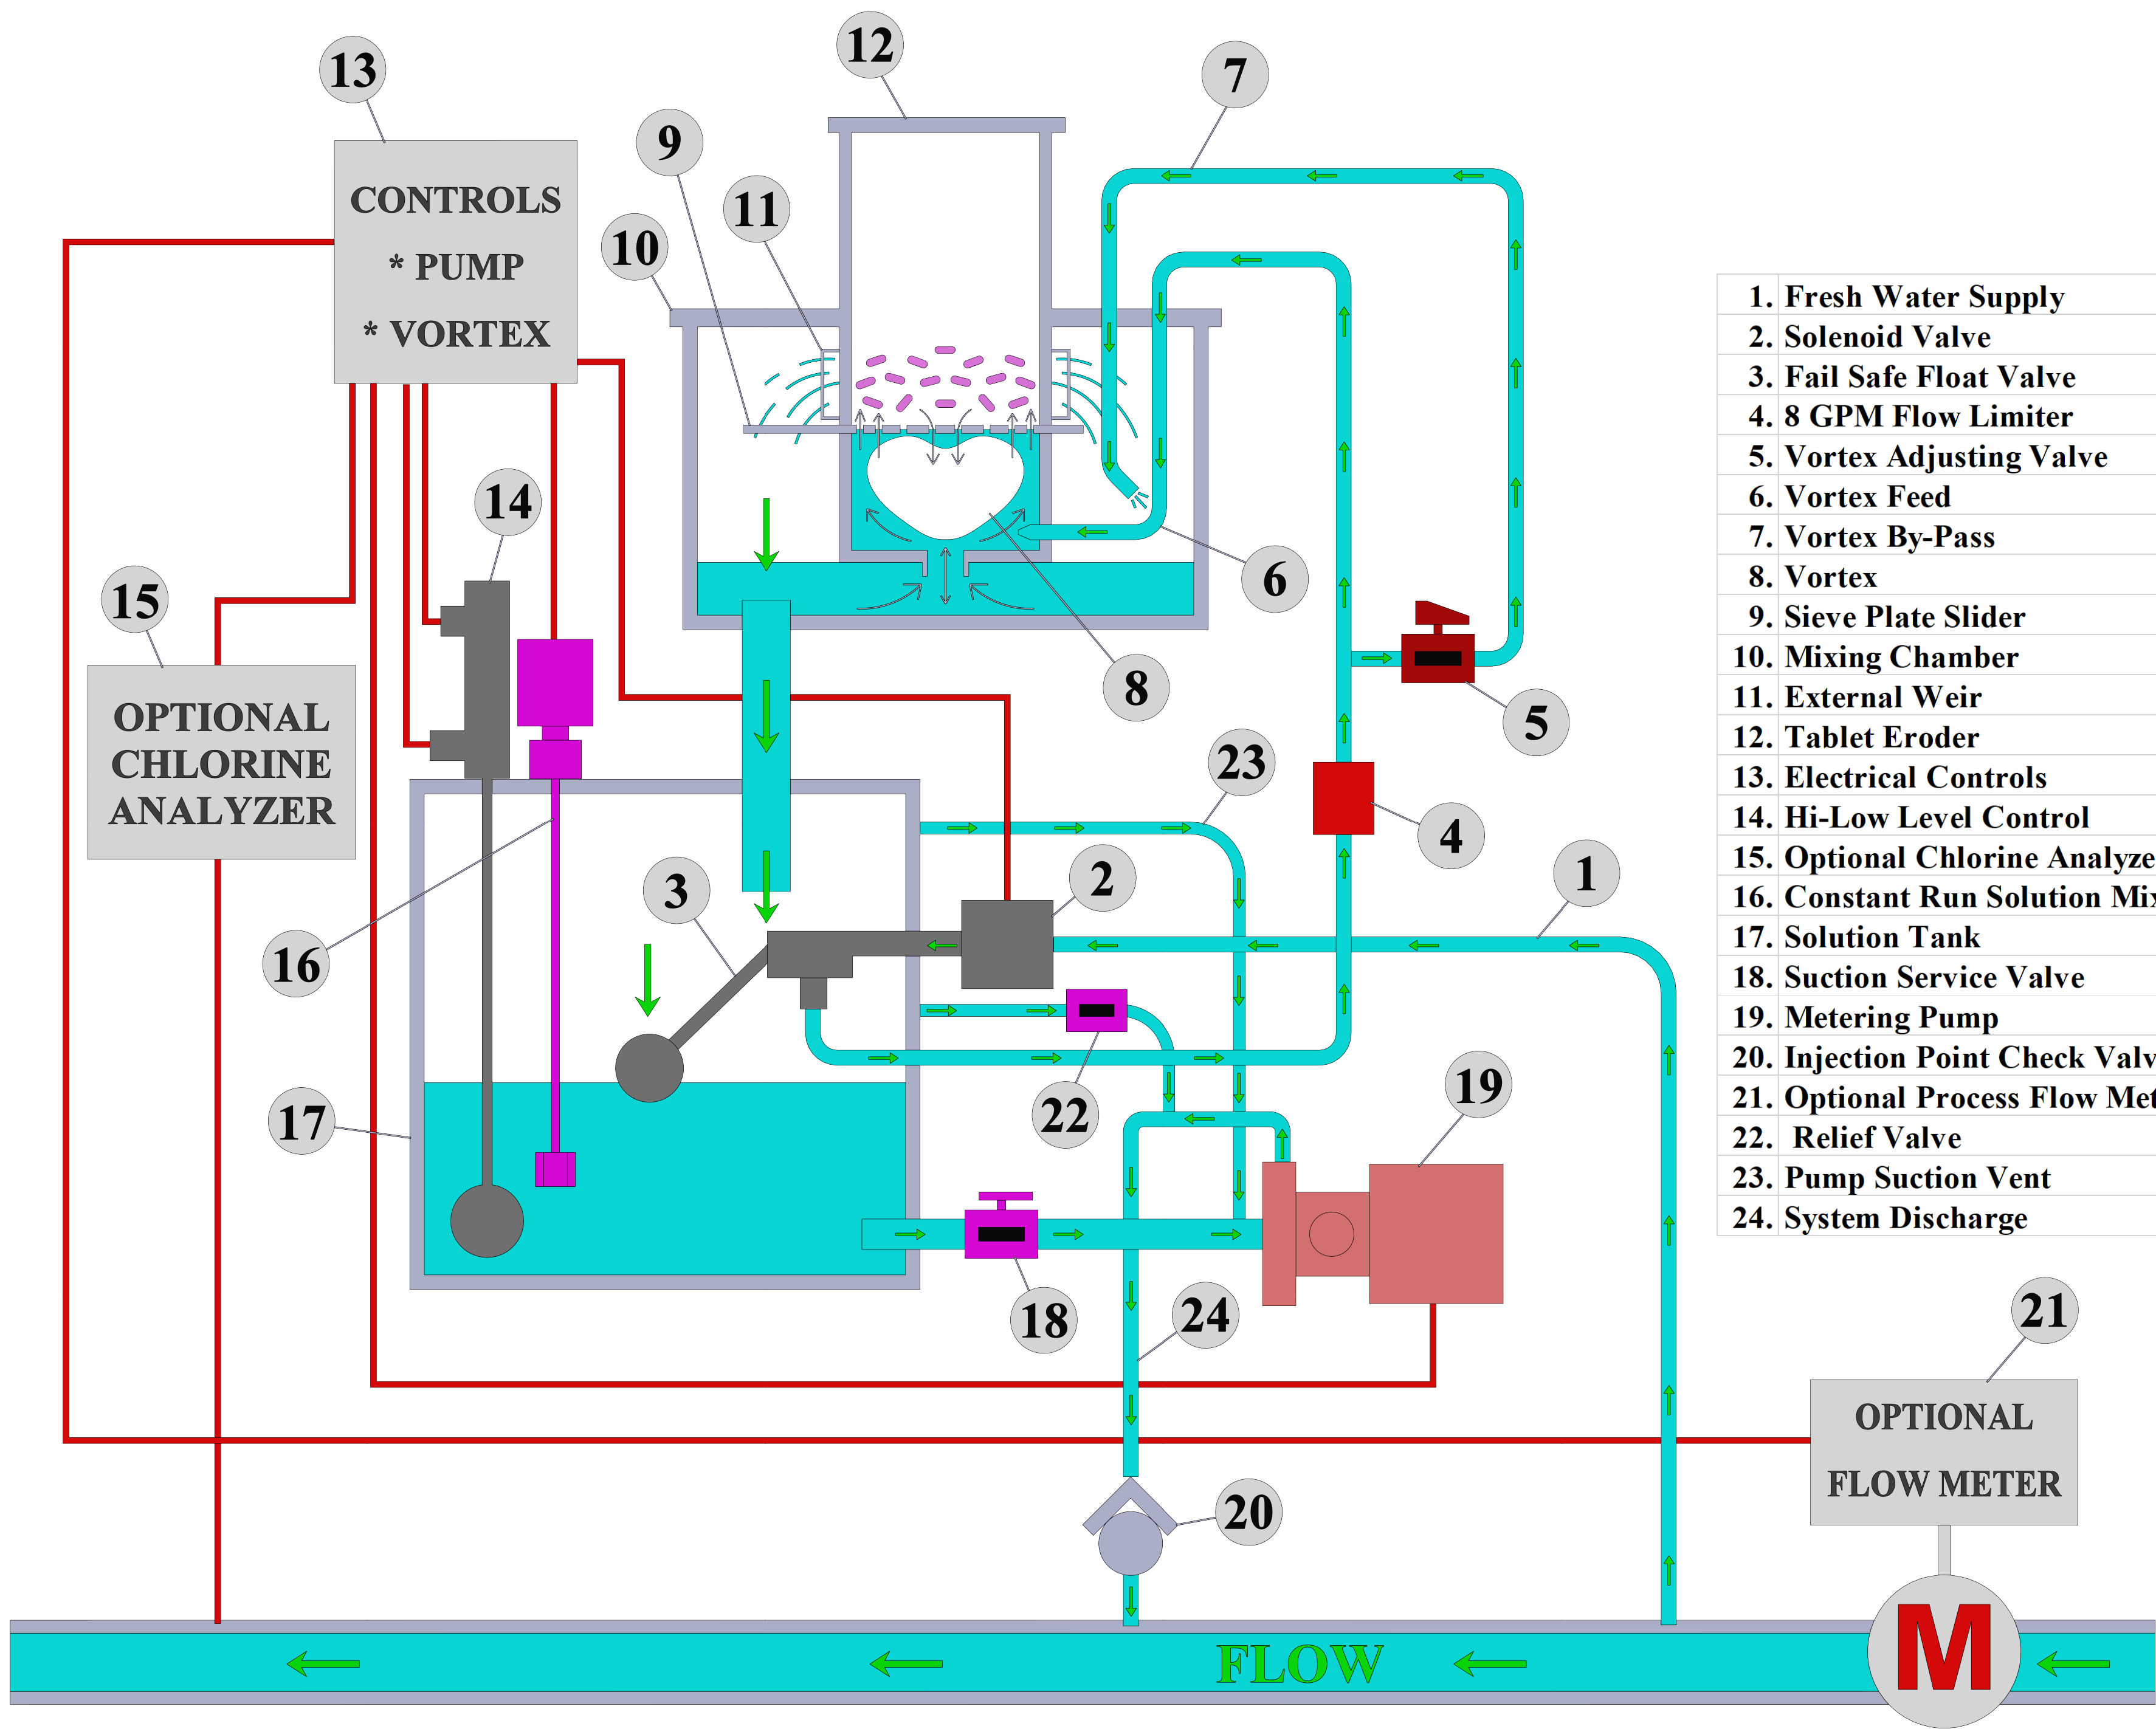

1. Fresh Water Supply
2. Solenoid Valve
3. Fail Safe Float Valve
4. 8 GPM Flow Limiter
5. Vortex Adjusting Valve
6. Vortex Feed
7. Vortex By-Pass
8. Vortex
9. Sieve Plate Slider
10. Mixing Chamber
11. External Weir
12. Tablet Eroder
13. Electrical Controls
14. Hi-Low Level Control
15. Optional Chlorine Analyzer
16. Constant Run Solution Mixer
17. Solution Tank
18. Suction Service Valve
19. Metering Pump
20. Injection Point Check Valve
21. Optional Process Flow Meter
22. Relief Valve
23. Pump Suction Vent
24. System Discharge

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

1

REV.

05/29/2024

JH

ADD ITEMS 22,23,24

DATE

APPROVED

NOTES: 1) OVERALL DIMENSIONAL CALL-OUT: 28-5/8" (W) X 56-1/8" (L) X 60" (H)