


HTS-80 SYSTEM COMPONENT CALL-OUT

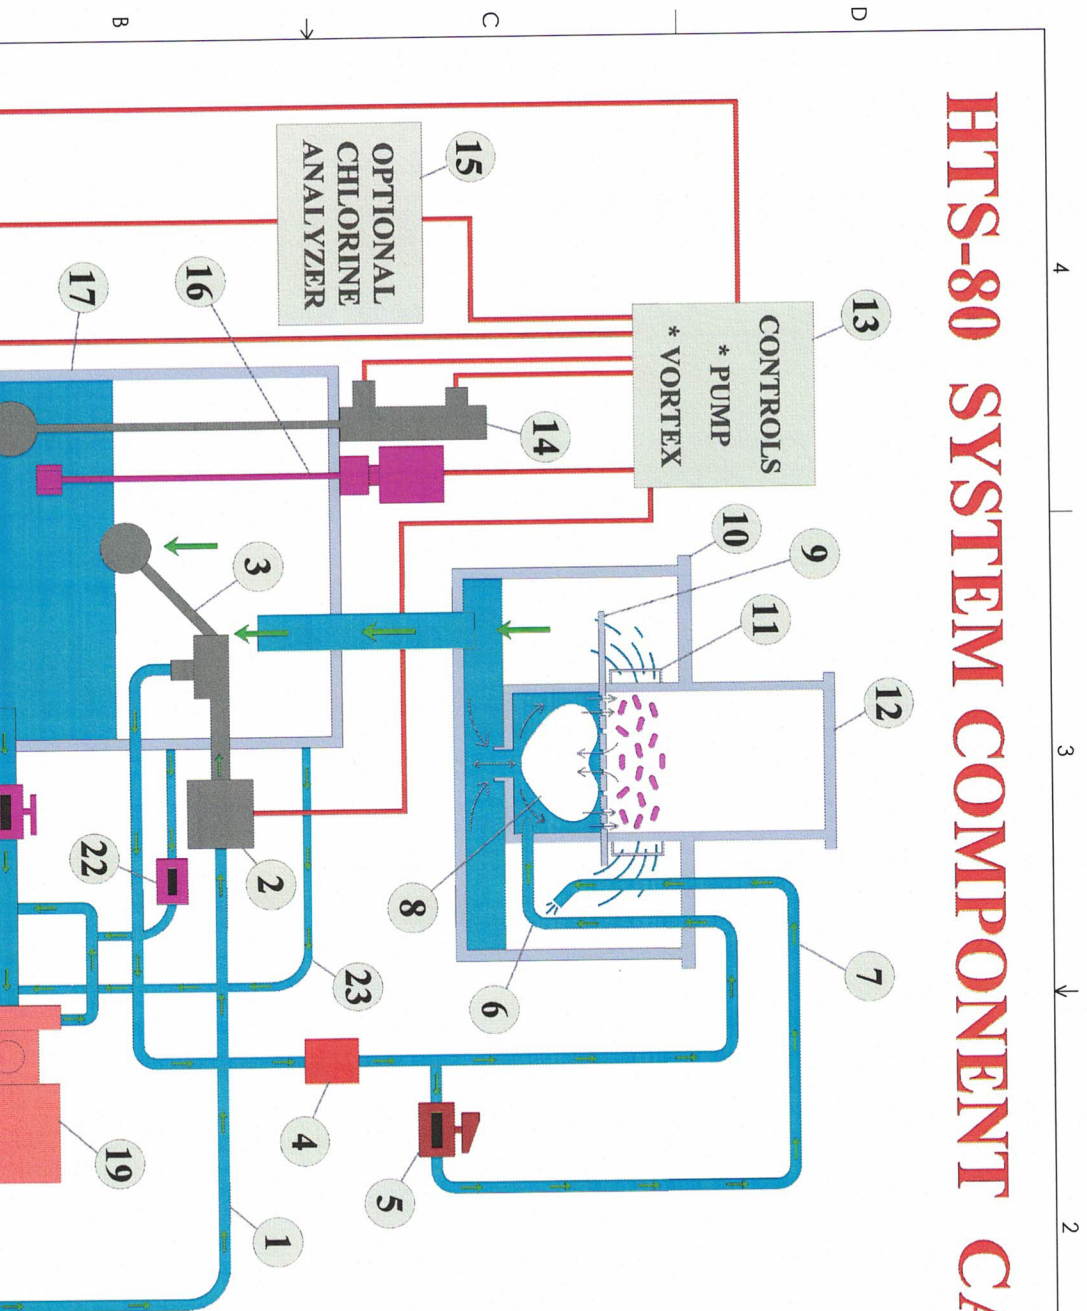

1. Fresh Water Supply
2. Solenoid Valve
3. Fail Safe Float Valve
4. 8 GPM Flow Limiter
5. Vortex Adjusting Valve
6. Vortex Feed
7. Vortex By-Pass
8. Vortex
9. Sieve Plate Slider
10. Mixing Chamber
11. External Weir
12. Tablet Eroder
13. Electrical Controls
14. Hi-Low Level Control
15. Optional Chlorine Analyzer
16. Constant Run Solution Mixer
17. Solution Tank
18. Suction Service Valve
19. Metering Pump
20. Injection Point Check Valve
21. Optional Process Flow Meter
22. Relief Valve
23. Pump Suction Vent
24. System Discharge

HAMMONDS
DOC. APPROVED FOR
INITIAL RELEASE
ENG. CHANGE
X-REVISION
DATE 05/29/2024
BY JH

Hammonds		HAMMONDS TECHNICAL SERVICES INC www.hammondscos.com	
THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO HAMMONDS TECHNICAL SERVICES INC. THE INFORMATION CONTAINED HEREIN SHALL NOT BE DISCLOSED, DUPLICATED, USED IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN TO EVALUATE THIS DOCUMENT WITHOUT WRITTEN CONSENT OF HAMMONDS TECHNICAL SERVICES INC.			
DRAWN: CLD	DATE: 05/09/2024	TITLE: HTS-80 TECHNICAL SCHEMATIC PN:HIW-2.0	
ENGR: CH	DATE: 01/01/2024	3RD ANGLE PROJECTION	
PR MGR:	DATE:	DO NOT SCALE	
eSIGNATURES ON FILE		SCALE: NTS	WEIGHT: (H) 810.0 lbs
		REV. 1 SHEET 1 OF 1	